



SMITH PARK electric

Each pole has two 50 amp 230 volt outlets and two 20 amp 120 volt outlets, the 50 amp 230 volt outlets are not ground fault protected, the 120 volt outlets are ground fault protected. Below is a picture of the 50 amp angled plug (angled plug so the door can be closed) that can be used in the 230 outlets. These can be found at any electrical supply house one brand is Pass & Seymour Model number 3867. Do not take the boxes apart to wire in direct, contact balloon officials for help, if you do not have the electrical knowledge to change a plug do not attempt. Contact balloon officials.

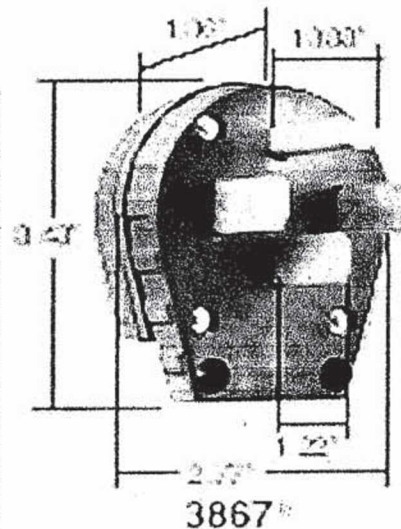

Neal Wilson
City of Middletown
Building maintenance tech

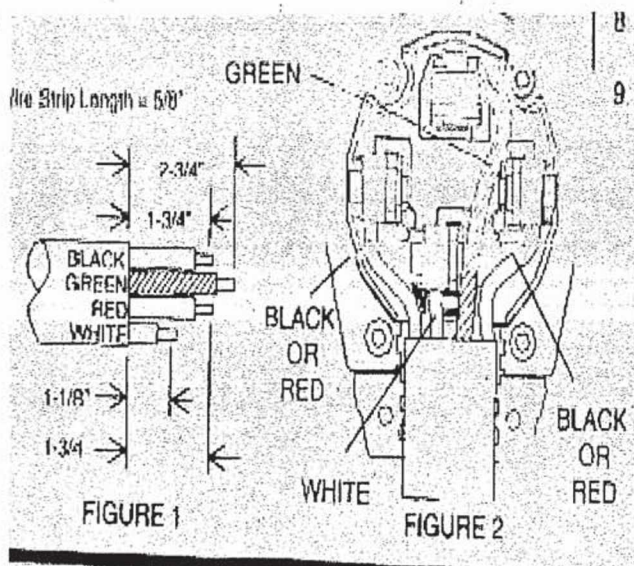

MIDDLETOWN DIVISION OF FIRE

2300 ROOSEVELT BLVD.
MIDDLETOWN, OHIO 45044-4799
(513) 425-7996
STEVEN M. BOTTS, FIRE CHIEF



Re: Fire Code Requirements for Tents

Ohio Fire Code Article 20, section 2002.6 requires that **ALL** tents or air-supported structures have at least one portable fire extinguisher with a minimum 4-A rating or two fire extinguishers with a minimum 2-A rating.

Ohio Fire Code Article 20, section 2002.2 prohibits cooking in tents. However, the Middletown Division of Fire will allow cooking in tents under the following conditions:

1. An approved fire extinguisher with a minimum rating of 2A-20BC shall be present in all tents used for cooking. The extinguisher will need to have a service tag showing that it has been serviced in the past year.
2. The use of propane burners and grills will be permitted as long as the flame does not exceed 2 inches in height and the cooking equipment is placed toward the rear of the tent and is a minimum of 36 inches away from any combustible material.
3. All propane cylinders should be outside the rear of the tent and secured so that it cannot fall or be knocked over.
4. The use of charcoal grills and deep fryers **will not** be permitted inside the tent and must be a minimum of 10 feet outside the tent.
5. The use of heating or warming ovens shall be a minimum of 24 inches from any combustible material.
6. An unobstructed exit way shall be provided in each tent used for cooking.
7. There will be **NO** cooking in any tents that are being used for an assembly occupancy.
8. If electrical extension cords are needed, they must be an approved outdoor heavy-duty extension cord. Household extension cords **will not** be approved.

****If the above requirements are not followed, there will be no cooking allowed in that booth until all of the requirements are met.**